


EM=358

LCMS Scan ESI+

Ret. Time: 3.73

F

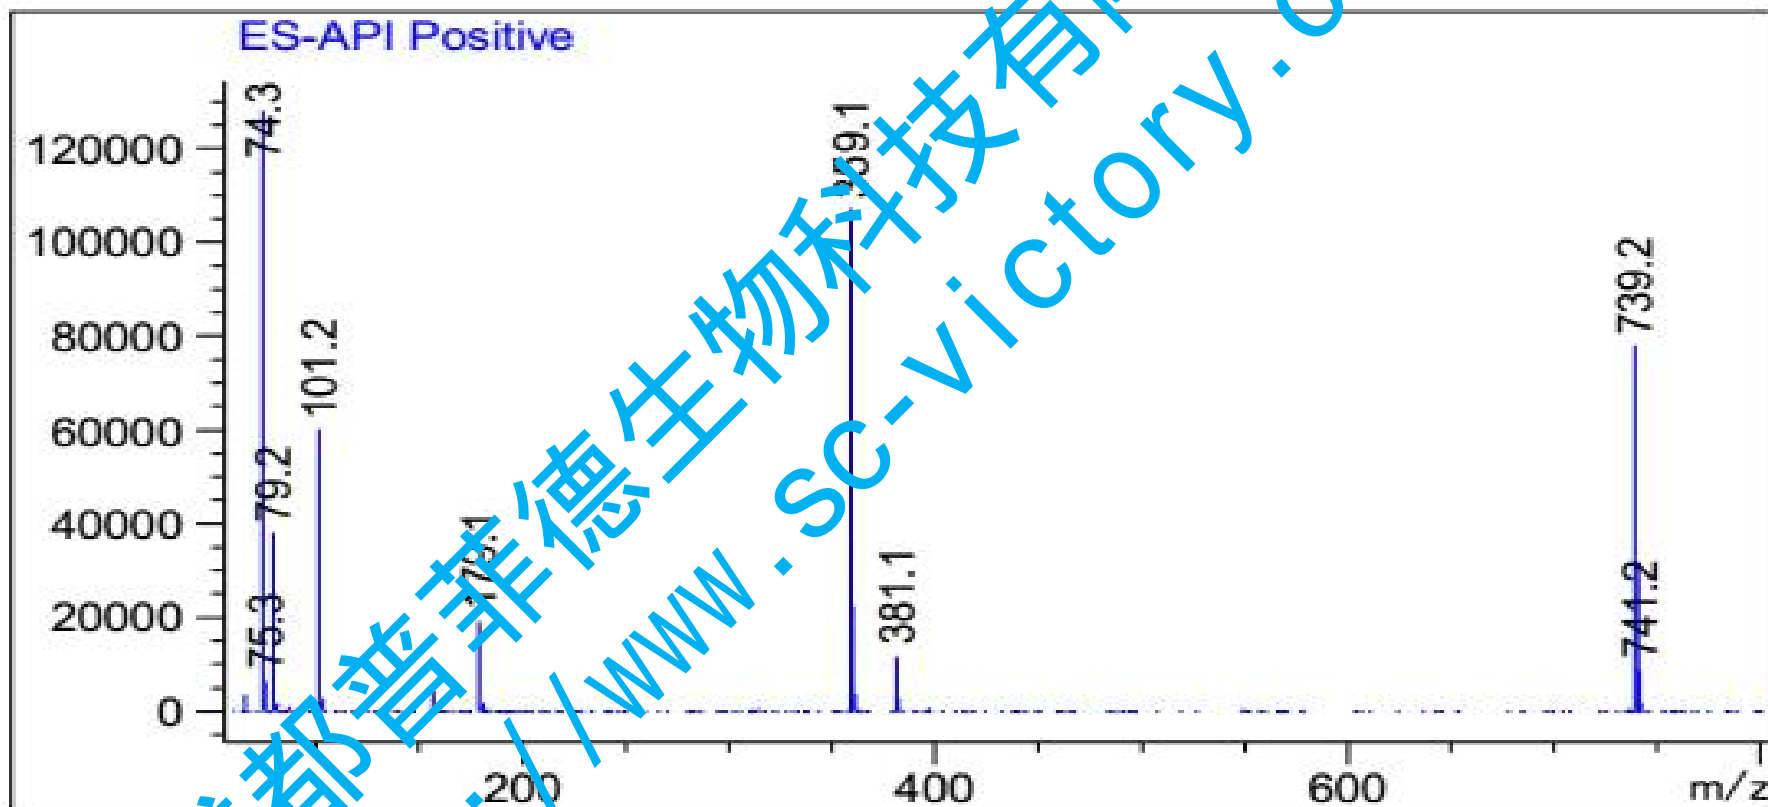

成都普菲德生物科技有限公司
<http://www.sc-victory.com>

EM=358

LCMS Scan ESI-

Ret. Time: 3.72 <<<< NEGATIVE SPECTRA >>>>

